Installation Smartline Terminal Power Strips : 935-T2DU

by Kondator
www.kondator.se

1a

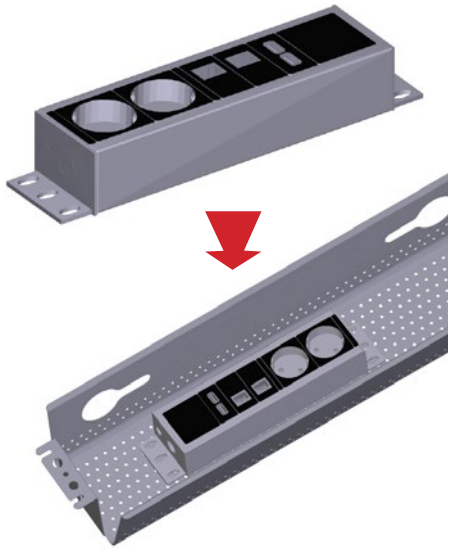

1b OR

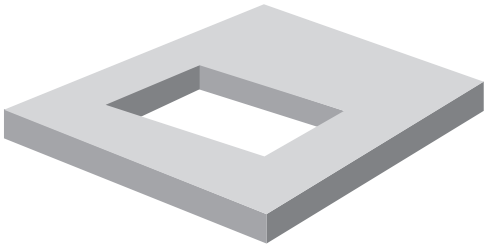

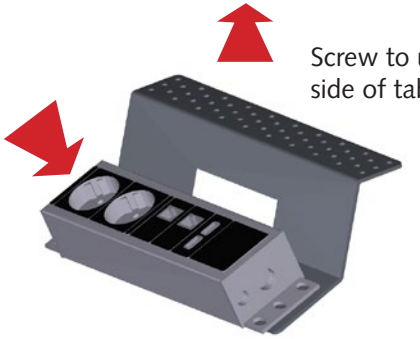

Screw to under-side of table

2

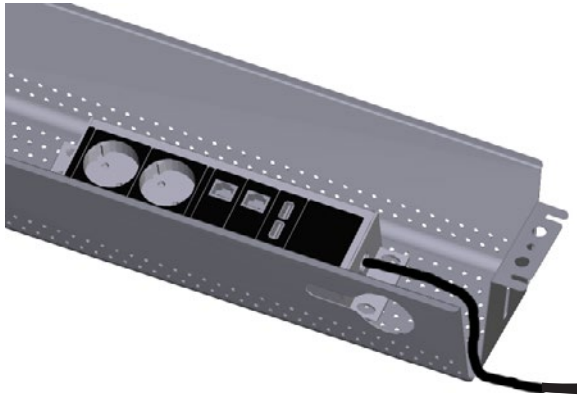



TP (Data)

Ext. cable not included

USB

Ext. cable not included

POWER (Wieland)

Ext. cable not included

WIELAND GST18I3S Female type
Part no 92.931.3053.1
VDE Approval no. 40018414

Cable cord specification
H05VV-F according to EN 50525-2-11
minimum 3 x 1.5 mm²

Accessories
Wieland <-> Schuko
1.5 m 935-BA15
3.0 m 935-BA30
5.0 m 935-BA50

Recommended Accessories

429-C093 Allround Cable Tray

935-TK28 Mounting Bracket



935-TA28 TopAccess Allround Cover



Kondator AB, Energivägen 8 - Box 121, SE-135 23 TYRESÖ, SWEDEN